

Regulations Compliance Report

Approved Document L1A, 2013 Edition, England assessed by Stroma FSAP 2012 program, Version: 1.0.4.7

Printed on 07 July 2017 at 16:52:01

Project Information:

Assessed By: Nicholas Barker (STRO027174)

Building Type: Flat

Dwelling Details:

NEW DWELLING DESIGN STAGE

Total Floor Area: 47.04m²

Site Reference : Holwell Road

Plot Reference: Plot 22 - TF Flat

Address : Plot 22, Holwell Road, Pirton

Client Details:

Name: CALA Homes (Chiltern) Ltd

Address : Riverside House, Holtspur Lane, Wooburn Green, Buckinghamshire, HP10 0TJ

This report covers items included within the SAP calculations.

It is not a complete report of regulations compliance.

1a TER and DER

Fuel for main heating system: Mains gas

Fuel factor: 1.00 (mains gas)

Target Carbon Dioxide Emission Rate (TER) 21.53 kg/m²

Dwelling Carbon Dioxide Emission Rate (DER) 20.28 kg/m² **OK**

1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE) 53.8 kWh/m²

Dwelling Fabric Energy Efficiency (DFEE) 48.0 kWh/m² **OK**

2 Fabric U-values

Element	Average	Highest	
External wall	0.24 (max. 0.30)	0.25 (max. 0.70)	OK
Floor	(no floor)		
Roof	0.13 (max. 0.20)	0.20 (max. 0.35)	OK
Openings	1.36 (max. 2.00)	1.40 (max. 3.30)	OK

2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

3 Air permeability

Air permeability at 50 pascals 5.01 (design value)

Maximum 10.0 **OK**

4 Heating efficiency

Main Heating system: Database: (rev 415, product index 017956):
Boiler systems with radiators or underfloor heating - mains gas
Brand name: Ideal
Model: LOGIC COMBI ESP1
Model qualifier: 30
(Combi)
Efficiency 89.6 % SEDBUK2009
Minimum 88.0 % **OK**

Secondary heating system: None

Regulations Compliance Report

5 Cylinder insulation

Hot water Storage: No cylinder

6 Controls

Space heating controls TTZC by plumbing and electrical services **OK**

Hot water controls: No cylinder

No cylinder

Boiler interlock: Yes **OK**

7 Low energy lights

Percentage of fixed lights with low-energy fittings 100.0%

Minimum 75.0% **OK**

8 Mechanical ventilation

Not applicable

9 Summertime temperature

Overheating risk (Thames valley): Medium **OK**

Based on:

Overshading: Average or unknown

Windows facing: South 3.36m²

Windows facing: North 2m²

Windows facing: East 1.26m²

Ventilation rate: 3.00

Blinds/curtains: Dark-coloured curtain or roller blind

Closed 100% of daylight hours

10 Key features

Roofs U-value 0.11 W/m²K

Predicted Energy Assessment




Plot 22
Holwell Road
Pirton

Dwelling type:
Date of assessment:
Produced by:
Total floor area:

Top floor Flat
07 July 2017
Nicholas Barker
47.04 m²

This is a Predicted Energy Assessment for a property which is not yet complete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, an Energy Performance Certificate is required providing information about the energy performance of the completed property.

Energy performance has been assessed using the SAP 2012 methodology and is rated in terms of the energy use per square metre of floor area, energy efficiency based on fuel costs and environmental impact based on carbon dioxide (CO₂) emissions.

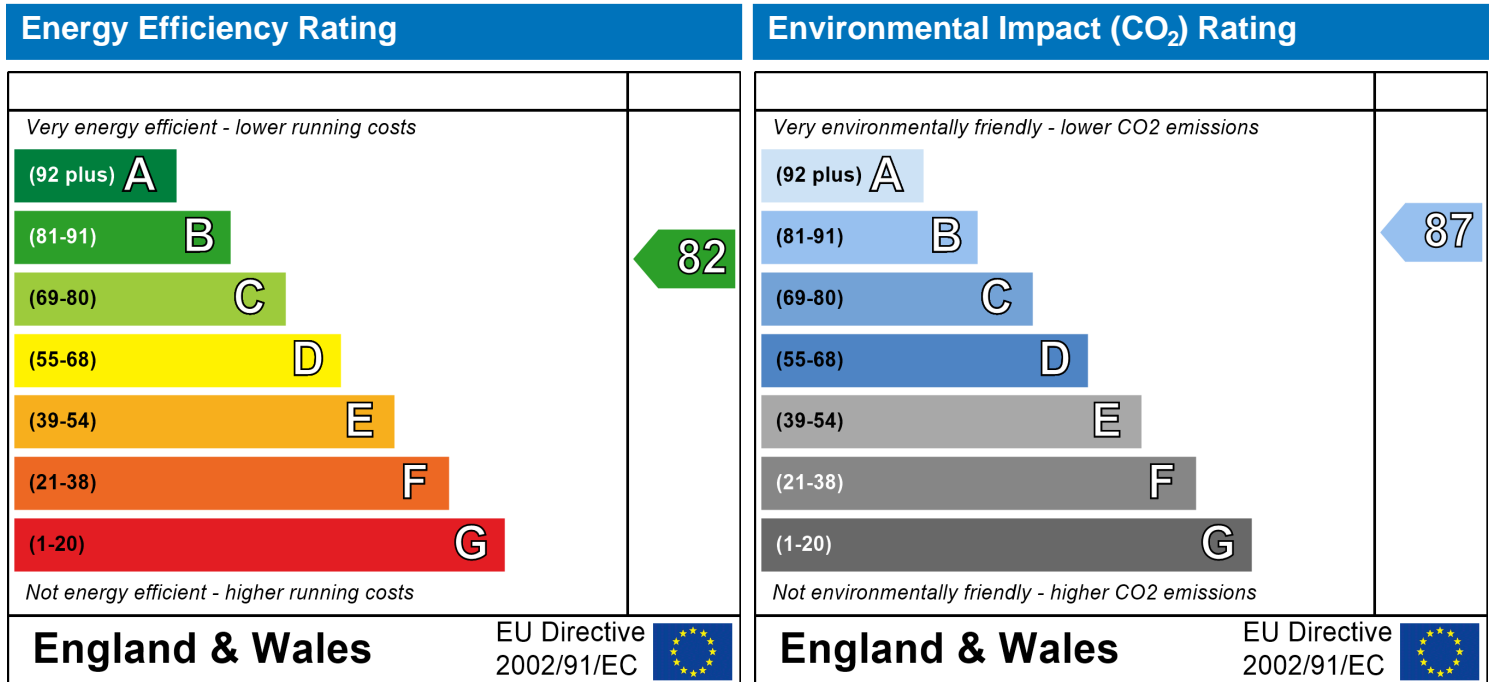

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO₂) emissions. The higher the rating the less impact it has on the environment.

SAP WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.51	0.5	0.49	0.44	0.43	0.38	0.38	0.37	0.4	0.43	0.45	0.47
------	-----	------	------	------	------	------	------	-----	------	------	------

Calculate effective air change rate for the applicable case

If mechanical ventilation:

0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) x Fmv (equation (N5)) , otherwise (23b) = (23a)

0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) =

0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) x [1 - (23c) ÷ 100]

(24a)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24b)

c) If whole house extract ventilation or positive input ventilation from outside

if (22b)m < 0.5 x (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 x (23b)

(24c)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24c)

d) If natural ventilation or whole house positive input ventilation from loft

if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m= 0.63 0.62 0.62 0.6 0.59 0.57 0.57 0.57 0.58 0.59 0.6 0.61 (24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m= 0.63 0.62 0.62 0.6 0.59 0.57 0.57 0.57 0.58 0.59 0.6 0.61 (25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m ²)	Openings m ²	Net Area A ,m ²	U-value W/m ² K	A X U (W/K)	k-value kJ/m ² -K	A X k kJ/K
Doors			1.89	x 1.2	= 2.268		(26)
Windows Type 1			3.36	x 1/[1/(1.4)+ 0.04]	= 4.45		(27)
Windows Type 2			2	x 1/[1/(1.4)+ 0.04]	= 2.65		(27)
Windows Type 3			1.26	x 1/[1/(1.4)+ 0.04]	= 1.67		(27)
Walls Type1	24.04	5.36	18.68	x 0.24	= 4.48	60	1120.8 (29)
Walls Type2	18.02	1.89	16.13	x 0.25	= 4.02	60	967.8 (29)
Walls Type3	17.57	1.26	16.31	x 0.24	= 3.91	60	978.6 (29)
Walls Type4	0.6	0	0.6	x 0.25	= 0.15	60	36 (29)
Roof Type1	38.73	0	38.73	x 0.11	= 4.26	9	348.57 (30)
Roof Type2	12.42	0	12.42	x 0.2	= 2.48	9	111.78 (30)
Total area of elements, m ²			111.38				(31)
Party floor			47.04			40	1881.6 (32a)
Internal wall **			67.39			9	606.51 (32c)

* for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2

** include the areas on both sides of internal walls and partitions

Fabric heat loss, W/K = S (A x U) (26)...(30) + (32) = 30.36 (33)

Heat capacity Cm = S(A x k) ((28)...(30) + (32) + (32a)...(32e) = 6051.66 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K = (34) ÷ (4) = 128.65 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.62 (36)

SAP WorkSheet: New dwelling design stage

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = (37)

Ventilation heat loss calculated monthly (38)m = 0.33 x (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	22.88	22.7	22.52	21.67	21.52	20.78	20.78	20.65	21.06	21.52	21.84	22.17	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.86	59.67	59.49	58.65	58.49	57.76	57.76	57.62	58.04	58.49	58.81	59.14	
Average = Sum(39) _{1...12} / 12 =												<input type="text" value="58.65"/> (39)	

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.27	1.27	1.26	1.25	1.24	1.23	1.23	1.22	1.23	1.24	1.25	1.26	
Average = Sum(40) _{1...12} / 12 =												<input type="text" value="1.25"/> (40)	

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement:

kWh/year:

Assumed occupancy, N (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA - 13.9)²)] + 0.0013 x (TFA - 13.9)

if TFA ≤ 13.9, N = 1

Annual average hot water usage in litres per day V_{d,average} = (25 x N) + 36 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more than 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	79.51	76.62	73.73	70.84	67.94	65.05	65.05	67.94	70.84	73.73	76.62	79.51	
Total = Sum(44) _{1...12} =												<input type="text" value="867.38"/> (44)	

Energy content of hot water used - calculated monthly = 4.190 x V_{d,m} x nm x DT_m / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	117.91	103.13	106.42	92.78	89.02	76.82	71.18	81.68	82.66	96.33	105.15	114.19	
Total = Sum(45) _{1...12} =												<input type="text" value="1137.27"/> (45)	

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	17.69	15.47	15.96	13.92	13.35	11.52	10.68	12.25	12.4	14.45	15.77	17.13	(46)
--------	-------	-------	-------	-------	-------	-------	-------	-------	------	-------	-------	-------	------

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): (48)

Temperature factor from Table 2b (49)

Energy lost from water storage, kWh/year (48) x (49) = (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) (51)

If community heating see section 4.3

Volume factor from Table 2a (52)

Temperature factor from Table 2b (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = (54)

Enter (50) or (54) in (55) (55)

SAP WorkSheet: New dwelling design stage

Water storage loss calculated for each month

$$((56)m = (55) \times (41)m$$

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
--------	---	---	---	---	---	---	---	---	---	---	---	---	------

If cylinder contains dedicated solar storage, $(57)m = (56)m \times [(50) - (H11)] \div (50)$, else $(57)m = (56)m$ where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)
--------	---	---	---	---	---	---	---	---	---	---	---	---	------

Primary circuit loss (annual) from Table 3

0

(58)

Primary circuit loss calculated for each month $(59)m = (58) \div 365 \times (41)m$

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)
--------	---	---	---	---	---	---	---	---	---	---	---	---	------

Combi loss calculated for each month $(61)m = (60) \div 365 \times (41)m$

(61)m=	14.5	13.08	14.45	13.96	14.4	13.91	14.36	14.38	13.93	14.43	14	14.49	(61)
--------	------	-------	-------	-------	------	-------	-------	-------	-------	-------	----	-------	------

Total heat required for water heating calculated for each month $(62)m = 0.85 \times (45)m + (46)m + (57)m + (59)m + (61)m$

(62)m=	132.41	116.2	120.87	106.73	103.42	90.73	85.54	96.07	96.59	110.76	119.15	128.68	(62)
--------	--------	-------	--------	--------	--------	-------	-------	-------	-------	--------	--------	--------	------

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRs and/or WWHRs applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)
--------	---	---	---	---	---	---	---	---	---	---	---	---	------

Output from water heater

(64)m=	132.41	116.2	120.87	106.73	103.42	90.73	85.54	96.07	96.59	110.76	119.15	128.68	Output from water heater (annual) _{1...12}	1307.16	(64)

Heat gains from water heating, kWh/month $0.25 \times [0.85 \times (45)m + (61)m] + 0.8 \times [(46)m + (57)m + (59)m]$

(65)m=	42.83	37.56	39	34.34	33.2	29.02	27.26	30.76	30.97	35.64	38.46	41.59	(65)
--------	-------	-------	----	-------	------	-------	-------	-------	-------	-------	-------	-------	------

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	96.21	96.21	96.21	96.21	96.21	96.21	96.21	96.21	96.21	96.21	96.21	96.21	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	33.33	29.6	24.08	18.23	13.62	11.5	12.43	16.16	21.68	27.53	32.13	34.26	(67)
--------	-------	------	-------	-------	-------	------	-------	-------	-------	-------	-------	-------	------

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	208.29	210.45	205	193.41	178.77	165.01	155.82	153.66	159.11	170.7	185.34	199.1	(68)
--------	--------	--------	-----	--------	--------	--------	--------	--------	--------	-------	--------	-------	------

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	46.22	46.22	46.22	46.22	46.22	46.22	46.22	46.22	46.22	46.22	46.22	46.22	(69)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)
--------	---	---	---	---	---	---	---	---	---	---	---	---	------

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	-64.14	(71)
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	------

Water heating gains (Table 5)

(72)m=	57.57	55.89	52.41	47.69	44.62	40.3	36.64	41.34	43.01	47.9	53.42	55.9	(72)
--------	-------	-------	-------	-------	-------	------	-------	-------	-------	------	-------	------	------

Total internal gains = $(66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m$

(73)m=	380.48	377.24	362.79	340.62	318.31	298.11	286.18	292.45	305.1	327.43	352.19	370.55	(73)
--------	--------	--------	--------	--------	--------	--------	--------	--------	-------	--------	--------	--------	------

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

SAP WorkSheet: New dwelling design stage

Orientation:	Access Factor Table 6d	Area m ²	Flux Table 6a	g_ Table 6b	FF Table 6c	Gains (W)
North	0.9x	2	10.63	0.5	1.11	8.19 (74)
North	0.9x	2	20.32	0.5	1.11	15.65 (74)
North	0.9x	2	34.53	0.5	1.11	26.59 (74)
North	0.9x	2	55.46	0.5	1.11	42.71 (74)
North	0.9x	2	74.72	0.5	1.11	57.53 (74)
North	0.9x	2	79.99	0.5	1.11	61.59 (74)
North	0.9x	2	74.68	0.5	1.11	57.5 (74)
North	0.9x	2	59.25	0.5	1.11	45.62 (74)
North	0.9x	2	41.52	0.5	1.11	31.97 (74)
North	0.9x	2	24.19	0.5	1.11	18.63 (74)
North	0.9x	2	13.12	0.5	1.11	10.1 (74)
North	0.9x	2	8.86	0.5	1.11	6.83 (74)
East	0.9x	1.26	19.64	0.5	1.11	9.53 (76)
East	0.9x	1.26	38.42	0.5	1.11	18.64 (76)
East	0.9x	1.26	63.27	0.5	1.11	30.69 (76)
East	0.9x	1.26	92.28	0.5	1.11	44.77 (76)
East	0.9x	1.26	113.09	0.5	1.11	54.86 (76)
East	0.9x	1.26	115.77	0.5	1.11	56.16 (76)
East	0.9x	1.26	110.22	0.5	1.11	53.47 (76)
East	0.9x	1.26	94.68	0.5	1.11	45.93 (76)
East	0.9x	1.26	73.59	0.5	1.11	35.7 (76)
East	0.9x	1.26	45.59	0.5	1.11	22.12 (76)
East	0.9x	1.26	24.49	0.5	1.11	11.88 (76)
East	0.9x	1.26	16.15	0.5	1.11	7.83 (76)
South	0.9x	3.36	46.75	0.5	1.11	60.48 (78)
South	0.9x	3.36	76.57	0.5	1.11	99.05 (78)
South	0.9x	3.36	97.53	0.5	1.11	126.17 (78)
South	0.9x	3.36	110.23	0.5	1.11	142.6 (78)
South	0.9x	3.36	114.87	0.5	1.11	148.6 (78)
South	0.9x	3.36	110.55	0.5	1.11	143 (78)
South	0.9x	3.36	108.01	0.5	1.11	139.72 (78)
South	0.9x	3.36	104.89	0.5	1.11	135.69 (78)
South	0.9x	3.36	101.89	0.5	1.11	131.8 (78)
South	0.9x	3.36	82.59	0.5	1.11	106.83 (78)
South	0.9x	3.36	55.42	0.5	1.11	71.69 (78)
South	0.9x	3.36	40.4	0.5	1.11	52.26 (78)

Solar gains in watts, calculated for each month

(83)m = Sum(74)m ... (82)m

(83)m=	78.19	133.33	183.45	230.07	260.99	260.75	250.69	227.24	199.47	147.57	93.67	66.92	(83)
--------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	-------	-------	------

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	458.67	510.57	546.24	570.69	579.3	558.87	536.87	519.69	504.56	475	445.86	437.47	(84)
--------	--------	--------	--------	--------	-------	--------	--------	--------	--------	-----	--------	--------	------

SAP WorkSheet: New dwelling design stage

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.94	0.92	0.88	0.82	0.72	0.58	0.44	0.47	0.65	0.83	0.91	0.95	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.22	19.46	19.81	20.24	20.6	20.85	20.95	20.94	20.78	20.32	19.71	19.18	(87)
--------	-------	-------	-------	-------	------	-------	-------	-------	-------	-------	-------	-------	------

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.86	19.87	19.87	19.88	19.89	19.9	19.9	19.9	19.89	19.89	19.88	19.87	(88)
--------	-------	-------	-------	-------	-------	------	------	------	-------	-------	-------	-------	------

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.93	0.9	0.86	0.79	0.67	0.5	0.34	0.37	0.58	0.79	0.9	0.94	(89)
--------	------	-----	------	------	------	-----	------	------	------	------	-----	------	------

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	17.55	17.89	18.38	18.98	19.47	19.78	19.87	19.86	19.69	19.12	18.26	17.5	(90)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------	------

fLA = Living area ÷ (4) = 0.55 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.47	18.75	19.17	19.68	20.09	20.37	20.47	20.46	20.29	19.78	19.06	18.43	(92)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.47	18.75	19.17	19.68	20.09	20.37	20.47	20.46	20.29	19.78	19.06	18.43	(93)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Utilisation factor for gains, hm:

(94)m=	0.91	0.89	0.85	0.78	0.68	0.54	0.4	0.43	0.61	0.79	0.88	0.92	(94)
--------	------	------	------	------	------	------	-----	------	------	------	------	------	------

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	418.99	452.9	462.96	445.69	394.06	299.52	213.14	221.04	307.49	374.51	393.67	403.16	(95)
--------	--------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	------

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
--------	-----	-----	-----	-----	------	------	------	------	------	------	-----	-----	------

Heat loss rate for mean internal temperature, Lm , W =[(93)m – (96)m]

(97)m=	848.35	826.75	753.65	632.04	490.97	333.39	223.36	233.83	359.45	537.1	703.46	841.38	(97)
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	-------	--------	--------	------

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	319.44	251.23	216.27	134.17	72.11	0	0	0	0	120.97	223.05	326.03	(98)
--------	--------	--------	--------	--------	-------	---	---	---	---	--------	--------	--------	------

Total per year (kWh/year) = Sum(98)_{1...5,9...12} = 1663.27 (98)

Space heating requirement in kWh/m²/year 35.36 (99)

9a. Energy requirements – Individual heating systems including micro-CHP

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.5 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

SAP WorkSheet: New dwelling design stage

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Space heating requirement (calculated above)	319.44	251.23	216.27	134.17	72.11	0	0	0	0	120.97	223.05	326.03	kWh/year
(211)m = $\{[(98)m \times (204)]\} \times 100 \div (206)$													(211)
	352.98	277.6	238.97	148.26	79.67	0	0	0	0	133.66	246.47	360.26	
Total (kWh/year) = Sum(211) _{1..5,10..12} =													1837.86 (211)
Space heating fuel (secondary), kWh/month													
= $\{[(98)m \times (201)]\} \times 100 \div (208)$													
(215)m =	0	0	0	0	0	0	0	0	0	0	0	0	
Total (kWh/year) = Sum(215) _{1..5,10..12} =													0 (215)
Water heating													
Output from water heater (calculated above)	132.41	116.2	120.87	106.73	103.42	90.73	85.54	96.07	96.59	110.76	119.15	128.68	
Efficiency of water heater													87.3 (216)
(217)m =	89.54	89.46	89.33	89.05	88.59	87.3	87.3	87.3	87.3	88.94	89.36	89.57	(217)
Fuel for water heating, kWh/month													
(219)m = (64)m x 100 ÷ (217)m													
(219)m =	147.88	129.89	135.31	119.85	116.74	103.93	97.98	110.04	110.65	124.53	133.34	143.66	
Total = Sum(219a) _{1..12} =													1473.81 (219)
Annual totals													
													kWh/year
Space heating fuel used, main system 1													1837.86
Water heating fuel used													1473.81
Electricity for pumps, fans and electric keep-hot													
central heating pump:											30	(230c)	
boiler with a fan-assisted flue											45	(230e)	
Total electricity for the above, kWh/year											sum of (230a)...(230g) =		75 (231)
Electricity for lighting													235.45 (232)

10a. Fuel costs - individual heating systems:

	Fuel kWh/year		Fuel Price (Table 12)		Fuel Cost £/year
Space heating - main system 1	(211) x		3.48	x 0.01 =	63.96 (240)
Space heating - main system 2	(213) x		0	x 0.01 =	0 (241)
Space heating - secondary	(215) x		13.19	x 0.01 =	0 (242)
Water heating cost (other fuel)	(219)		3.48	x 0.01 =	51.29 (247)
Pumps, fans and electric keep-hot	(231)		13.19	x 0.01 =	9.89 (249)
(if off-peak tariff, list each of (230a) to (230g) separately as applicable and apply fuel price according to Table 12a)					
Energy for lighting	(232)		13.19	x 0.01 =	31.06 (250)
Additional standing charges (Table 12)					120 (251)
Appendix Q items: repeat lines (253) and (254) as needed					
Total energy cost	(245)...(247) + (250)...(254) =				276.19 (255)

SAP WorkSheet: New dwelling design stage

11a. SAP rating - individual heating systems

Energy cost deflator (Table 12)		0.42	(256)
Energy cost factor (ECF)	$[(255) \times (256)] \div [(4) + 45.0] =$	1.26	(257)
SAP rating (Section 12)		82.42	(258)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	Emission factor kg CO2/kWh		Emissions kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	396.98 (261)
Space heating (secondary)	(215) x	0.519	=	0 (263)
Water heating	(219) x	0.216	=	318.34 (264)
Space and water heating	(261) + (262) + (263) + (264) =			715.32 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93 (267)
Electricity for lighting	(232) x	0.519	=	122.2 (268)
Total CO2, kg/year		sum of (265)...(271) =		876.44 (272)
CO2 emissions per m²		(272) ÷ (4) =		18.63 (273)
El rating (section 14)				87 (274)

13a. Primary Energy

	Energy kWh/year	Primary factor		P. Energy kWh/year
Space heating (main system 1)	(211) x	1.22	=	2242.19 (261)
Space heating (secondary)	(215) x	3.07	=	0 (263)
Energy for water heating	(219) x	1.22	=	1798.05 (264)
Space and water heating	(261) + (262) + (263) + (264) =			4040.25 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	3.07	=	230.25 (267)
Electricity for lighting	(232) x	0	=	722.83 (268)
'Total Primary Energy		sum of (265)...(271) =		4993.32 (272)
Primary energy kWh/m²/year		(272) ÷ (4) =		106.15 (273)