

# PREDICTED ENERGY ASSESSMENT


Plot 177, Rogerson Gardens,  
Preston,  
PR3

Dwelling type: House, Semi-Detached  
Date of assessment: 29/04/2022  
Produced by: Hazel Black  
Total floor area: 69.7 m<sup>2</sup>  
DRRN: 8222-5848-1031

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO<sub>2</sub>) emissions.

## Energy Efficiency Rating

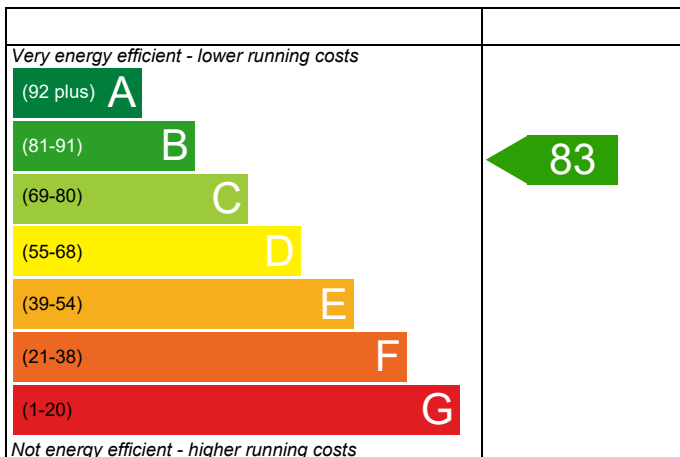


**England**

EU Directive  
2002/91/EC

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

## Environmental Impact (CO<sub>2</sub>) Rating

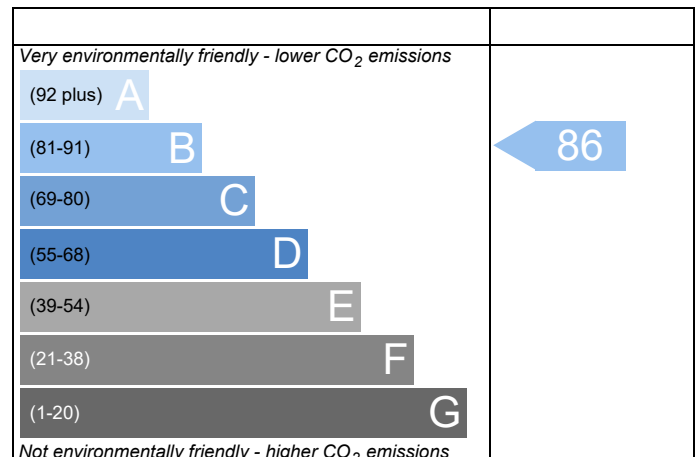

**England**

EU Directive  
2002/91/EC

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

This report has been produced by an accredited Elmhurst member whose work is subject to quality assurance audits. The data used to produce the report has been verified by the Elmhurst members' portal.



# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Property Reference	Plot 177 T50 SD		Issued on Date	29/04/2022	
Assessment Reference	1	Prop Type Ref			
Property	Plot 177, Rogerson Gardens, Preston, PR3				
SAP Rating	83 B	DER	18.89	TER	19.68
Environmental	86 B	% DER<TER	4.02		
CO <sub>2</sub> Emissions (t/year)	1.21	DFEE	50.11	TFEE	53.91
General Requirements Compliance	Pass	% DFEE<TFEE	7.06		
Assessor Details	Ms. Hazel Black, Hazel Black, Tel: 01582 544250, hazelb@ee-ltd.co.uk		Assessor ID	M003-0001	
Client					

### SUMMARY FOR INPUT DATA FOR New Build (As Designed)

#### Criterion 1 – Achieving the TER and TFEE rate

##### 1a TER and DER

Fuel for main heating	Mains gas		
Fuel factor	1.00 (mains gas)		
Target Carbon Dioxide Emission Rate (TER)	19.68	kgCO <sub>2</sub> /m <sup>2</sup>	
Dwelling Carbon Dioxide Emission Rate (DER)	18.89	kgCO <sub>2</sub> /m <sup>2</sup>	Pass
	-0.79 (-4.0%)	kgCO <sub>2</sub> /m <sup>2</sup>	

##### 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	53.91	kWh/m <sup>2</sup> /yr	
Dwelling Fabric Energy Efficiency (DFEE)	50.11	kWh/m <sup>2</sup> /yr	
	-3.8 (-7.1%)	kWh/m <sup>2</sup> /yr	Pass

#### Criterion 2 – Limits on design flexibility

##### Limiting Fabric Standards

##### 2 Fabric U-values

Element	Average	Highest	
External wall	0.27 (max. 0.30)	0.27 (max. 0.70)	Pass
Party wall	0.00 (max. 0.20)	-	Pass
Floor	0.15 (max. 0.25)	0.15 (max. 0.70)	Pass
Roof	0.11 (max. 0.20)	0.11 (max. 0.35)	Pass
Openings	1.28 (max. 2.00)	1.41 (max. 3.30)	Pass

##### 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

##### 3 Air permeability

Air permeability at 50 pascals	5.01 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	
Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	Pass

##### Limiting System Efficiencies

##### 4 Heating efficiency

This report has been produced by an accredited Elmhurst member whose work is subject to quality assurance audits. The data used to produce the report has been verified by the Elmhurst members' portal.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Main heating system

Boiler system with radiators or underfloor - Mains gas  
Data from database  
Ideal LOGIC COMBI ESP1 35  
Combi boiler  
Efficiency: 89.6% SEDBUK2009  
Minimum: 88.0%

Pass

Secondary heating system

None

### 5 Cylinder insulation

Hot water storage

No cylinder

### 6 Controls

Space heating controls

Time and temperature zone control

Pass

Hot water controls

No cylinder

Boiler interlock

Yes

Pass

### 7 Low energy lights

Percentage of fixed lights with low-energy fittings

100 %

Minimum

75 %

Pass

### 8 Mechanical ventilation

Not applicable

## Criterion 3 – Limiting the effects of heat gains in summer

### 9 Summertime temperature

Overheating risk (West Pennines (England))

Not significant

Pass

Based on:

Overshading

Average

Windows facing North

1.32 m<sup>2</sup>, No overhang

Windows facing East

3.84 m<sup>2</sup>, No overhang

Windows facing West

4.32 m<sup>2</sup>, No overhang

Air change rate

4.00 ach

Blinds/curtains

Dark-coloured curtain or roller blind, closed 100% of daylight hours

## Criterion 4 – Building performance consistent with DER and DFEE rate

### Party Walls

Type

U-value

Filled Cavity with Edge Sealing

0.00 W/m<sup>2</sup>K

Pass

### Air permeability and pressure testing

#### 3 Air permeability

Air permeability at 50 pascals

5.01 (design value) m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Maximum

10.0 m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Pass

### 10 Key features

Party wall U-value

0.00 W/m<sup>2</sup>K

Roof U-value

0.11 W/m<sup>2</sup>K

Door U-value

1.00 W/m<sup>2</sup>K

*This report has been produced by an accredited Elmhurst member whose work is subject to quality assurance audits. The data used to produce the report has been verified by the Elmhurst members' portal.*

# RECOMMENDATIONS

	Typical cost	Typical savings per year	Energy efficiency	Environmental impact	Result
Low energy lights			0	0	Already installed
Solar water heating	£4,000 - £6,000	£23	B 84	B 88	Recommended
Photovoltaic	£3,500 - £5,500	£332	A 96	A 98	Recommended
Wind turbine			0	0	Not applicable
<b>Totals</b>	<b>£7,500 - £11,500</b>	<b>£355</b>	<b>A 96</b>	<b>A 98</b>	

*This report has been produced by an accredited Elmhurst member whose work is subject to quality assurance audits. The data used to produce the report has been verified by the Elmhurst members' portal.*

